Recommended System Schematics for LTAP Series Low Temperature Actuation Probes

Configuration 1: Orifice & Back Pressure Regulator (constant bleed)

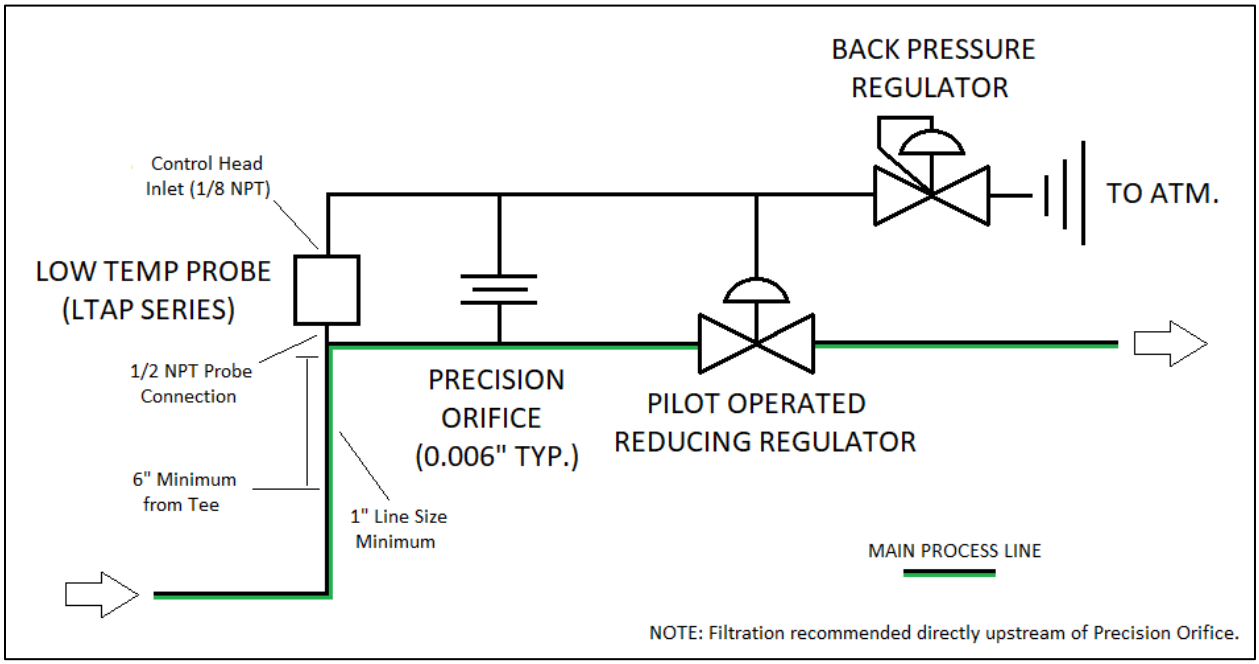

Configuration 2: Reducing Regulator & Orifice

NOTE: Reducing Regulator must be relieving type.

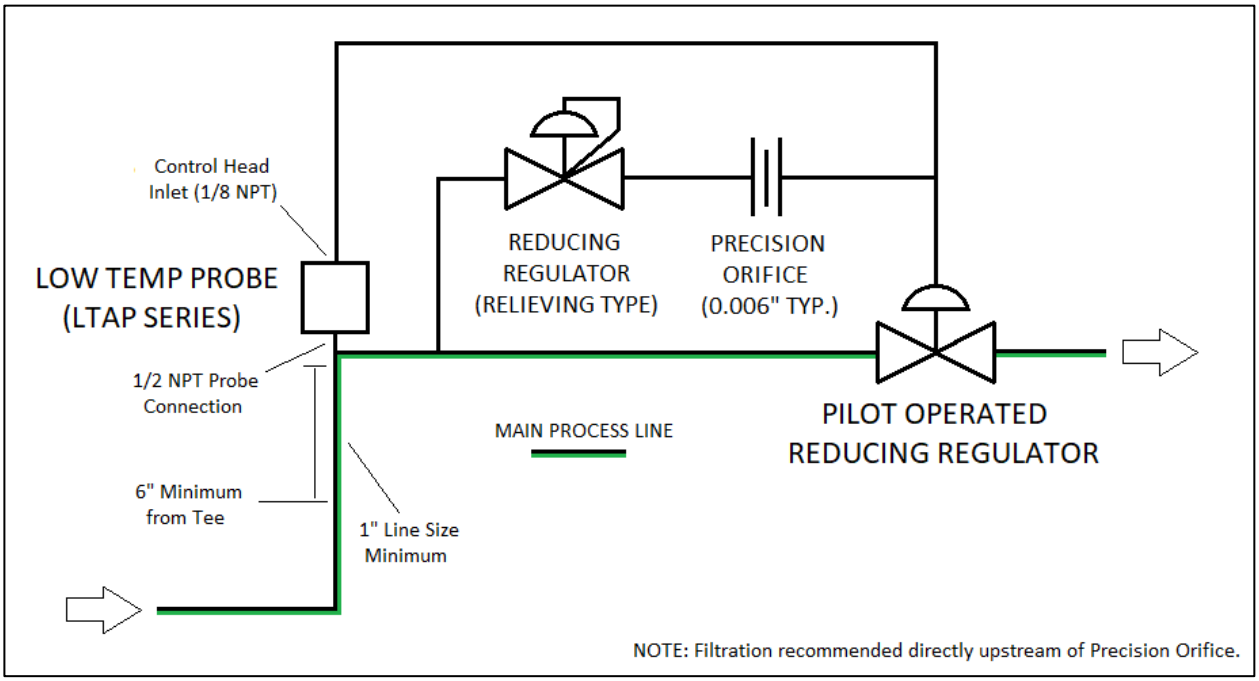

1865 Route 23 South, PO Box 768, Butler, New Jersey 07405 Phone 973.838.6500 Fax 973.838.4888