





# LIQUID CYLINDER VALVE

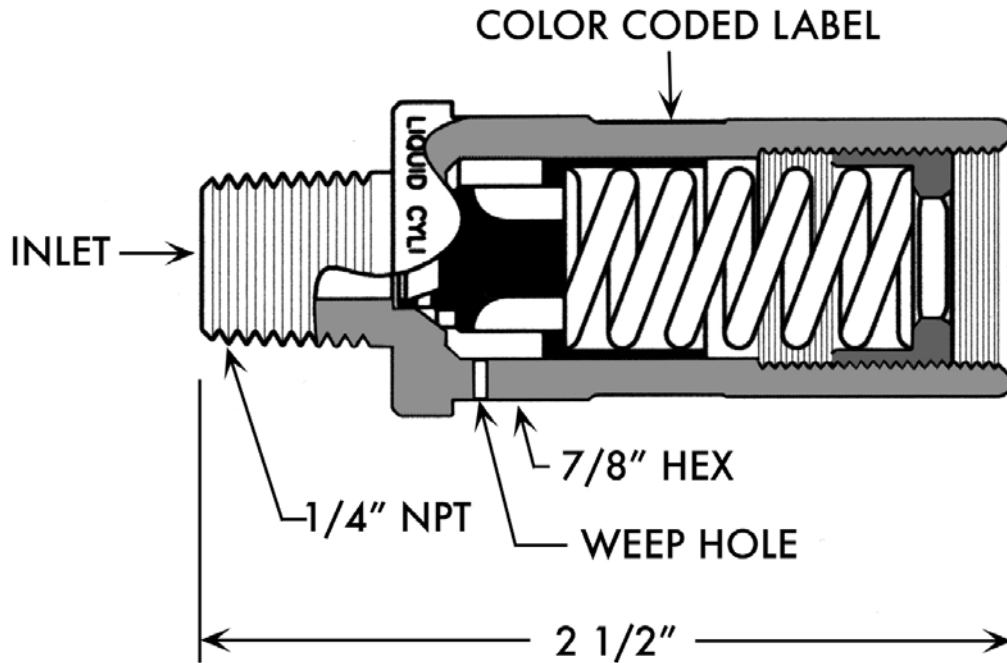

## Flow Data

| Set Pressure (PSIG) | Flow Rate (SCFM N2) |                   |
|---------------------|---------------------|-------------------|
|                     | 110% Set Pressure   | 120% Set Pressure |
| 22                  | 11.8                | 12.4              |
| 100                 | 21.8                | 31.0              |
| 230                 | 43.9                | 64.7              |
| 350                 | 61.2                | 85.3              |
| 500                 | 77.1                | 111.4             |

## How To Order

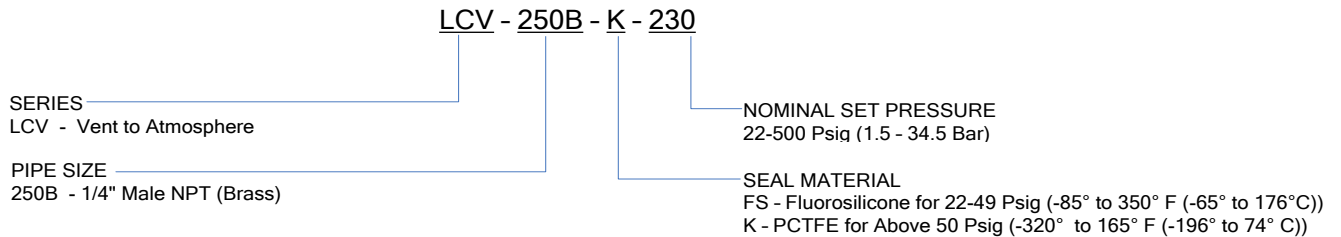

PROPER COMPONENT SELECTION – When specifying a component, the total system design must be considered to ensure safe and trouble-free performance. Intended component function, materials compatibility, pressure ratings, installation, environment and maintenance are the responsibility of the system designer.



[www.generant.com](http://www.generant.com)

1865 Route 23 South PO Box 768 Butler, New Jersey 07405 973.838.6500 Fax 973.838.4888

SA.SL.LCV001.F.2595